

SPECIFIC NOTES (APPLY TO DRAWING E-1.2 WHERE INDICATED):


1 CONNECT TO LIGHT FIXTURES ON LANDING BELOW.

2 CONNECT TO LIGHT FIXTURES ON LANDING ABOVE.

3 TO CAMERA

4 TO MICROPHONE

5 THE ELECTRICAL CONTRACTOR SHALL PROVIDE A JUNCTION BOX, CONTACTOR, RELAY, AND WIRE/CONDUIT. LOW VOLTAGE WIRING SYSTEM SHALL BE ACTIVE WHEN LINE VOLTAGE IS ENERGIZED. THE LOW VOLTAGE CABLING FOR MICROPHONE AND CAMERA WILL BE BY OTHERS. PROVIDE MATERIALS & ACCESSORIES REQUIRED FOR A COMPLETE & SATISFACTORY INSTALLATION.

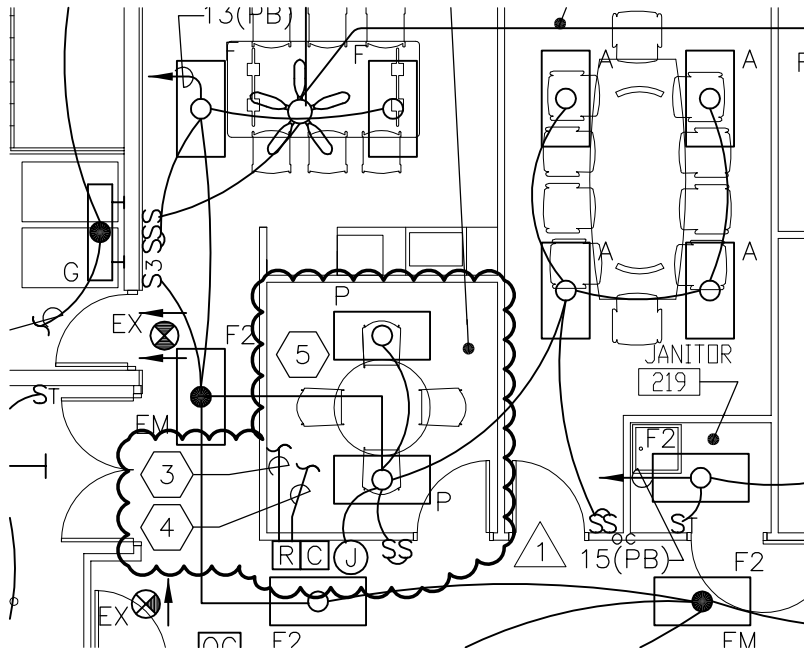

REFER TO DRAWINGS: E-1.2

ADDENDUM REVISION

**BRAMBLETON PUBLIC SAFETY CENTER
BELMONT RIDGE ROAD
BRAMBLETON, VIRGINIA**

BIGNELL/WATKINS/HASSER ARCHITECTS
ONE PARK PLACE, SUITE 250 ANNAPOLIS, MARYLAND 21401



**SCHLENGER / PITZ
& ASSOCIATES, INC.**
Consulting Engineers

15 West Aylesbury Road, Timonium, Maryland 21093
Phone 410.561.1337
Fax 410.561.1446
WWW.SPAENGINEERS.COM
© Copyright 2011 Schlenker/Pitz & Associates, Inc.

DATE: 04/27/2011

SCALE: NOT TO SCALE

DWG. NO:

SKE-12-1